

Techno-Economic Analysis of Harmonic Disturbances in a University Environment - A Case Study at the University of Cape Coast

Joseph Cudjoe Attachie^{1,*}, Benedict Addo-Yeboah²

¹Department of Electrical and Electronic Engineering, University of Mines and Technology, Tarkwa, Ghana

²Directorate of Physical Development and Estate Management, University of Cape Coast, Cape Coast, Ghana

Email address:

jattachie@umat.edu.gh (J. C. Attachie), addoyeboah@gmail.com (B. Addo-Yeboah)

*Corresponding author

To cite this article:

Joseph Cudjoe Attachie, Benedict Addo-Yeboah. Techno-Economic Analysis of Harmonic Disturbances in a University Environment - A Case Study at the University of Cape Coast. *Journal of Electrical and Electronic Engineering*. Vol. 10, No. 4, 2022, pp. 128-141.

doi: 10.11648/j.jeeec.20221004.11

Received: June 27, 2022; **Accepted:** July 15, 2022; **Published:** July 22, 2022

Abstract: This research investigates the adverse impact of harmonic disturbances present in distribution substations on the electrical installations and distribution network of the University of Cape Coast in economic terms. Power quality analyser using the “very-short time” monitoring duration and referenced against the IEEE 519-2014 harmonics standard was employed to obtain both the voltage total harmonic distortion (THD_V) and current total harmonic distortion (THD_I). The average total harmonic distortions measured on the university was 16.43% with dominant harmonics of the 3rd, 5th, 7th, 11th and 13th orders culminating in a reduced true power factor of 0.944. Further computations and analysis on the network showed a reduction of the THD_I level from 16.43% to 8%. Modelling and simulation of the electrical distribution system was also carried out using Electrical Transient and Analysis Program (ETAP) software. The extracted harmonic waveforms and spectrums revealed harmonics of the 3rd, 5th, 7th and 9th orders to be more dominant within the network. Significant improvement of the true power factor with considerable savings of about Gh¢ 1,161,493.71 per annum was realised. The installation of tuned paralleled passive filters to mitigate harmonics gave a net present value of Gh¢ 2,736,028.00 at a discount rate of 8% with a payback period of 6.23 years.

Keywords: Harmonic Distortion, Non-Linear Loads, Distribution Network, Modelling and Simulation, Harmonic Mitigation, Harmonic Cost

1. Introduction

Electrical systems are extensively subjected to harmonic distortions in an unmitigated environment owing to the proliferation of non-linear loads that incorporate solid-state electronic components in their functionality and the increasing need for energy conservation. Arikan *et al.* suggests that the extensive usage of nonlinear loads is due to energy efficiency and improved functionality [1]. Consequently, cost of increased power losses and high utility bills are visible where the effects of harmonics are ignored. Other concession to the problem is noncompliance of equipment with harmonic standards, which further aggravates the pollution of the electrical network.

In Ghana, issues of power quality have not fully been

addressed and harmonics in particular, with its attendant consequences has been totally ignored [2, 3]. Power system monitoring carried out by Electricity Company of Ghana (ECG) in 2012 showed that an estimated Gh¢ 2,400,000.00 per annum is lost as heat in the distribution network as a result of harmonics [2]. This is expected, as there is not a harmonic standard in place to establish checks and to regulate the influx of non-compliant imported electronic based equipment. The practical side of this unintentional negligence is the entailed costs such as increased leakage, transformer overload and derating, conductor overload, joules effect losses in lines and machinery, higher electrical consumption etc. that are not always easy to detect and evaluate [4, 5]. Therefore, it is important to take necessary steps to curb the increasing impacts of harmonics and realise

some savings when quantified in absolute terms.

The electrical distribution network of the University of Cape Coast (UCC) accommodates over 80% nonlinear loads out of the total connected electrical loads. These harmonic producing loads create various disturbances on the electrical system. Meanwhile, newer installations with improved functionality and efficiency at the UCC do not conform to any harmonic standards. Overheating of electrical wirings in existing buildings is an outstanding issue in UCC owing to the high usage of electronics-based equipment. The existing building wirings were designed for relatively light office loads in the 1960s and 1970s, and may be overloaded by the present day trend of harmonic-producing loads [6, 7].

Magnetic or electronic ballast and capacitor banks including capacitors utilised in electrical equipment are prone to damages at the UCC. According to maintenance and procurement records, capacitors for motor starting and in air conditioners are indiscriminately botched. These capacitors and the auxiliary winding possibly create a series resonance that can be an ideal path for low-order harmonics which are already residing in the system thereby acting as harmonic sinks. Typical interaction of the capacitor motors with the system has no effect on power quality; however, damage to the capacitor motor due to excessive harmonic currents for which the motor generates a resonance condition may be of concern [8].

According to maintenance records obtained at the Electricity Section of the University, 55% of all lighting fluorescent tubes except for LEDs procured at the beginning of the year fuse out before end of year. Meanwhile, up to 35% of power packs become defective within the first three years according to the data obtained from the ICT Directorate of the University. 60% of the alternators in standby generators located at various facilities within the University have been rewinded at least once even though the operator defined limits for these generators in many cases were not exceeded.

Transformers situated at UCC hum quite nosily suggesting serious overloading and saturation. Conversely, various tests and measurements show a rather less loading with most units having around 65% although, increases in temperatures of hot spots and top oil was observed. This situation is akin to harmonic polluted power system according to Salles *et al.* and Zobaa *et al.* [9, 10].

Underground cables do not produce harmonics but the harmonic pollution at UCC is suspected to be exacerbated by the presence of underground cables which make up about 90% of the entire electrical distribution network according to the electrical distribution layout for the university. Cables may amplify any existing harmonic disturbances and can lower the frequency at which system resonance occurs due to the capacitance distributed along the cable length causing damage to capacitor banks [11].

The Electrical Installation Guide (2018) according to IEC International Standard suggests that, life span of equipment is significantly reduced when operated in harmonic environment exceeding 10% total harmonic distortion (THD). The estimated reductions are purportedly 32.5%, 18% and 5%

for single-phase loads, three-phase loads and transformers respectively. This effectively means that to retain the service lives equivalent to a rated load, equipment must be oversized whereas existing equipment face the threat of hastened ageing and early deterioration, as is the case for UCC.

In terms of cost, the university spent an estimated total of Gh¢ 84 633.00 on replacement of 28 W electronic ballasts, 100 W LED floodlights, 250 W magnetic chokes for streetlights and 2.5 μ F ceiling fan capacitors and 45 μ F air conditioning capacitors for facilities other than residential on campus according to records on 2017 annual expenditure of electrical items obtained from the Central Stores. An average of 210 pcs of 23 W CFLs at a unit cost of Gh¢ 13.20 and 122 pcs of UPS at a unit cost of Gh¢ 750.00 were replaced in the year 2019 alone according to Maintenance of Existing Buildings (MEB) booklets obtained from the Electrical Maintenance Unit. 54 pcs of LED floodlights used for area security lighting succumbed and were replaced in the year 2018 at an estimated cost of Gh¢ 37 746.00. The ICT Centre alone replaced 47 pcs, 31 pcs and 43 pcs of PC power supply units (power packs) for 2017, 2018 and 2019 years respectively.

The principal objective of this paper therefore, is to ascertain the veracity of the harmonic distortions in the electrical systems on the university campus and evaluate the economic implications of the impact of harmonic disturbances.

2. Theoretical Framework

2.1. Economic Consequences of Harmonics

The circulation of harmonic currents within any system or installations presents a hidden liability. The economic implications of harmonic disturbances are difficult to evaluate and not easily noticeable. However, certain obvious effects exist in assessing the economic impact of harmonics.

The costs of harmonics are estimated in terms of equipment derating, premature aging of electrical equipment, misoperation of electrical systems and reduced power factor.

2.1.1. Equipment Derating

In a harmonic polluted environment, power sources such as transformers, generators and UPS systems are oversized. Neutral conductors are also oversized since circulating triplen harmonics in the system tend to add up in the neutral. The phase conductors owing to the excessive losses due to joule effect are also oversized. The cost associated with derating and overdesign can be weighty.

2.1.2. Premature Ageing of Electrical Equipment

Studies reveal that service life of equipment operated in harmonic environment exceeding 10% THD₁ are set to reduce [12, 13]. The reduction, according to Electrical Installation Guide 2018 published by IEC International Standards has been estimated at 32.5% for single phase loads and 18% and 5% for three phase loads and transformers respectively thereby increasing their rate of replacement.

Table 1 shows the minimum service life expectancy for some selected harmonic loads [14].

Table 1. Minimum Service Life Expectancy for some Selected Harmonic Loads.

| Harmonic Load | Expected Average Service Life |
|--------------------------------------|-------------------------------|
| 23 W CFLs | 10 000 Lighting Hours |
| 100 W LED Floodlights | 50 000 Lighting Hours |
| 28 W Electronic Ballasts | 30 000 Lighting Hours |
| 250 W HPS Magnetic Ballasts | 65 000 Lighting Hours |
| 2.5 μ F Fan Capacitors (Class B) | 10 000 Hours Run |
| 45 μ F A/C Capacitors (Class B) | 50 000 Hours Run |
| PCs Power Pack | 80 000 'ON' Hours |
| 800 VA UPS Circuit Board | 12 years |

Frequent equipment replacement occasioned by harmonics can escalate capital expenses by 15% approximately and increase the costs of operation by virtually 10% [15].

2.1.3. Misoperation of Electrical Systems

The operating characteristics of frequency-dependent components within devices are affected by high harmonic frequencies which leads to misoperation of certain electronic component and the sporadic operation of circuit breakers which in turn results in nuisance tripping. This ultimately results in processes shutdown and operational downtimes. These downtimes can translate to huge financial losses.

2.1.4. Reduced Power Factor

The presence of harmonics increases the total apparent power demand in the network. Increase in the apparent power demand can plunge the contracted demand subscription into a higher tariff bracket. Also, depending on the tariff method employed by the utility, the reduction in the total power factor (PF) can result in power factor surcharges.

Typically, the PF are indicated on the utility bills as does ECG for bills submitted to customers. However, the indicated PF is the displacement power factor (DPF) and not the actual or true power factor. Owing to harmonics, distortion power factor (δ PF) plays a crucial part in determining the true power factor (TPF) with significant savings potential [14, 16, 17].

Invariably, the presence of harmonics signifies a reduced true power factor where improvement unlike displacement power factor, is only possible by harmonics mitigation. When the THD_i is mitigated to 8% THD_i or lower, Grady and Gilleskie proved that the distortion power factor can be considerably improved thereby consequently improving the net true power factor [17].

2.2. Displacement Power Factor, Distortion Power Factor and True Power Factor

There arises a complication when the power factor is computed for a signal in a harmonic environment since the attendant frequencies of the harmonics superimposed on the fundamental signal is taken into consideration. Thus, the conventional definition of power factor as the cosine of the angle between fundamental frequency voltage and current has proceeded to consider the rms values of signals, which

make up the contribution of components of different frequencies.

Displacement power factor (DPF) characterises the power frequency factor, while distortion power factors (δ PF) emerges as the index that pursues rms signal disparities.

The distortion power factor is determined as:

$$\delta = \frac{1}{\sqrt{1 + THD^2}} \quad (1)$$

The true power factor PF_{True} is defined as the product of the displacement power factor and distortion power factor. This is given by equation (2).

$$PF_{True} = DPF \times \delta PF = \cos \theta \times \frac{1}{\sqrt{1 + THD^2}} \quad (2)$$

In essence, DPF pertains to fundamental quantities only and PF_{True} pertains to both fundamental and harmonic quantities. Where harmonics are not present, the two factors are indistinguishable. However, where harmonics are present, PF_{True} is always smaller than the DPF. In view of the fact that true power factor is always less than unity, it also holds that:

$$PF_{True} \leq DPF \quad (3)$$

2.3. Important Indicators for Testing Project Viability

2.3.1. Benefit-Cost Ratio

Benefit Cost Ratio (BCR) is the ratio of gross return and total cost. BCR is used in cost benefit analysis to ascertain the overall relationship between the relative costs and benefits of a proposed project. Sapkota S. and Sapkota S. expressed benefit cost ratio as a ratio of benefit to cost, thus a division of the proposed total cash benefits of a project by the proposed total cash outlays of the project [18]. If the proposed project has a BCR that is greater than 1.0, the project is expected to deliver a positive net present value and will generate an internal rate of return above the discount rate used in the discounted cash flow calculations and should therefore be accepted.

A BCR of exactly 1.0 indicates a break-even point where benefits of the proposed project equate the cost. If the BCR is less than 1.0, it means the project's costs outweigh the benefits and should not be considered [19].

2.3.2. Net Present Value

The Net Present Value (NPV) is one of two approaches engaged in deciding courses of action in capital budgeting when discounted cash flows are to be considered [20]. The method comprises the computation of the difference between the present values of a project's cash inflows and the present values of the expected cash outflows [21].

The NPV while simpler to use also makes some reasonable assumptions and these make it more credible than the Internal Rate of Return. The NPV uses the cost of capital as the discounting rate and screening tool. Projects with positive NPVs are deemed worthy of the required investment and

provide insight into the economic efficiency and validity of the investment even though the criterion may not capture some practical considerations [22]. Projects with negative NPVs are rejected unless other factors dictate its acceptance [17].

3. Materials and Methods

3.1. The Power Distribution Network

The university is a Special Load Tariff (SLT) consumer and takes 11 kV bulk supply from the Electricity Company of Ghana (ECG) power network to its power distribution centre (PDC) located at the control station of the university. The 11 kV PDC equipped with a sulphur hexafluoride gas (SF₆) circuit breakers are fed from two 11 kV incoming feeders.

There are Sixteen (16) distribution transformer substations situated on the campus with a total installed capacity of 11.14 MW. Each substation is fitted with kVAr compensation equipment of appropriate capacity for power factor correction purposes. Table 2 shows the transformer substations and their respective nominal parameters. Underground cables of 3×185

mm² XLPE/PVC/SWA copper/aluminium are typically employed for the interconnection between the substations whereas armoured cables of 500 mm² single core XLPE/PVC/SWA copper are used for hooking the LV sides to the feeder pillars. In addition, these underground cables accounts for more than 80% of the high-tension (HT) distribution network. The HT distribution network on the campus has circuitry kilometres of 26.3 km.

3.2. Cost of Harmonics Due to Reduced Equipment Lifespan

Table 3 gives the estimated quantities of the selected harmonic loads replaced in 2017, 2018 and 2019 and total associated costs for academic and administrative facilities only. The selected harmonic loads at the university are evaluated in this thesis due to the rate of repairs and replacements performed on them. The harmonic loads include: 23 W CFLs, 100 W LED floodlights, 28 W electronic ballasts, 2.5 µF fan capacitors, 45 µF A/C capacitors, power supply units for computers and circuit boards for UPS.

Table 2. Parameters of Transformer Substations Situated at the University of Cape Coast.

| Name of Substation | Transformer Capacity (kVA) | Impedance (%) | Full Load Current (A) | Secondary Line Voltage (V _{L-L}) | Vector Group | Fitted Capacitor Bank (kVAr) |
|--------------------|----------------------------|---------------|-----------------------|--|--------------|------------------------------|
| Auditorium | 1000 | 4.54 | 1342 | 430 | Dyn 11 | 245.0 |
| Atlantic | 1000 | 4.55 | 1342 | 430 | Dyn 5 | 245.0 |
| Science | 1000 | 4.36 | 1332 | 433 | Dy 11 | 245.0 |
| Control Station | 1000 | 5.61 | 1440 | 400 | Dyn 5 | 200.0 |
| CoDE | 1000 | 4.47 | 1334 | 430 | Dy 11 | 200.0 |
| SRC/Medical | 1000 | 4.56 | 1333 | 433 | Dyn 11 | 245.0 |
| Library | 1000 | 4.56 | 1342 | 430 | Dy 11 | 245.0 |
| Northern | 750 | 4.55 | 1008 | 433 | Dyn 11 | 122.5 |
| Casford | 750 | 4.50 | 1000 | 433 | Dy 11 | 125.5 |
| Hill Top | 630 | 4.54 | 840 | 433 | Dy 11 | 125.5 |
| Superannuation | 500 | 4.05 | 696 | 415 | Dyn 11 | 122.5 |
| Ghana Hostels | 500 | 4.41 | 667 | 433 | Dyn 11 | 95.5 |
| Southern | 500 | 4.00 | 720 | 433 | Dy 11 | 122.5 |
| Valco-Trust | 500 | 5.00 | 667 | 433 | Dyn 11 | 95.5 |
| Tech Village | 100 | 4.28 | 135 | 430 | Dy 11 | 46.0 |
| Filling Station | 50 | 5.65 | 69 | 433 | Dyn 11 | Nil |

Table 3. Annual Cost Estimation of Selected Harmonic Loads Replacement.

| Selected Harmonic Loads | Year of Replacement | | | | | | | | |
|--------------------------|---------------------|-----|------------------|-----------------|-----|------------------|-----------------|-----|------------------|
| | 2017 | | | 2018 | | | 2019 | | |
| | Unit Cost (Ghc) | Qty | Total Cost (Ghc) | Unit Cost (Ghc) | Qty | Total Cost (Ghc) | Unit Cost (Ghc) | Qty | Total Cost (Ghc) |
| CFLs | 11.00 | 243 | 2673.00 | 12.50 | 176 | 2200.00 | 13.20 | 210 | 2772.00 |
| 100 W LED Lights | 655.00 | 54 | 35370.00 | 699.00 | 54 | 37746.00 | 720 | 42 | 30240.00 |
| 28 W Electronic Ballasts | 25.00 | 874 | 21850.00 | 26.50 | 652 | 17278.00 | 29.50 | 785 | 23157.50 |
| 250 W Choke | 70.53 | 268 | 18902.00 | 77.25 | 200 | 15450.00 | 80.34 | 165 | 13256.10 |
| 2.5 µF Fan Capacitor | 10.50 | 284 | 2982.00 | 12.10 | 165 | 1996.50 | 15.40 | 183 | 2818.20 |
| 45 µF A/C Capacitors | 42.00 | 68 | 2856.00 | 48.00 | 71 | 3408.00 | 56.00 | 64 | 3584.00 |
| PC PSUs | 230.00 | 87 | 20010.00 | 246.00 | 52 | 12792.00 | 288.00 | 56 | 16128.00 |
| 800 VA UPS | 505.00 | 175 | 189375.00 | 103.00 | 308 | 216524.00 | 287.00 | 150 | 91500.00 |
| Total Associated Cost | | | 193 018.00 | | | 166 795.00 | | | 183 455.80 |

3.3. Measurement Points

Harmonic evaluations were carried out at the Point of Common Coupling (PCC) in compliance with harmonic limits

as prescribed in the IEEE 519-2014 Standard. The point of common coupling according to the standard was taken as “the point in the electrical power system closest to the user, where other users are also connected.

For the commercial users supplied through a common

service transformer, the PCC is the low voltage (LV) bus of the transformer whereas the high voltage (HV) side of the dedicated transformer is commonly the PCC for industrial users such as a production plant.

Figure 1 gives sample single line diagrams illustrating typical LV distribution arrangement of the Science Complex and University Hospital LV networks respectively. The PCCs at these typical facilities are identified.

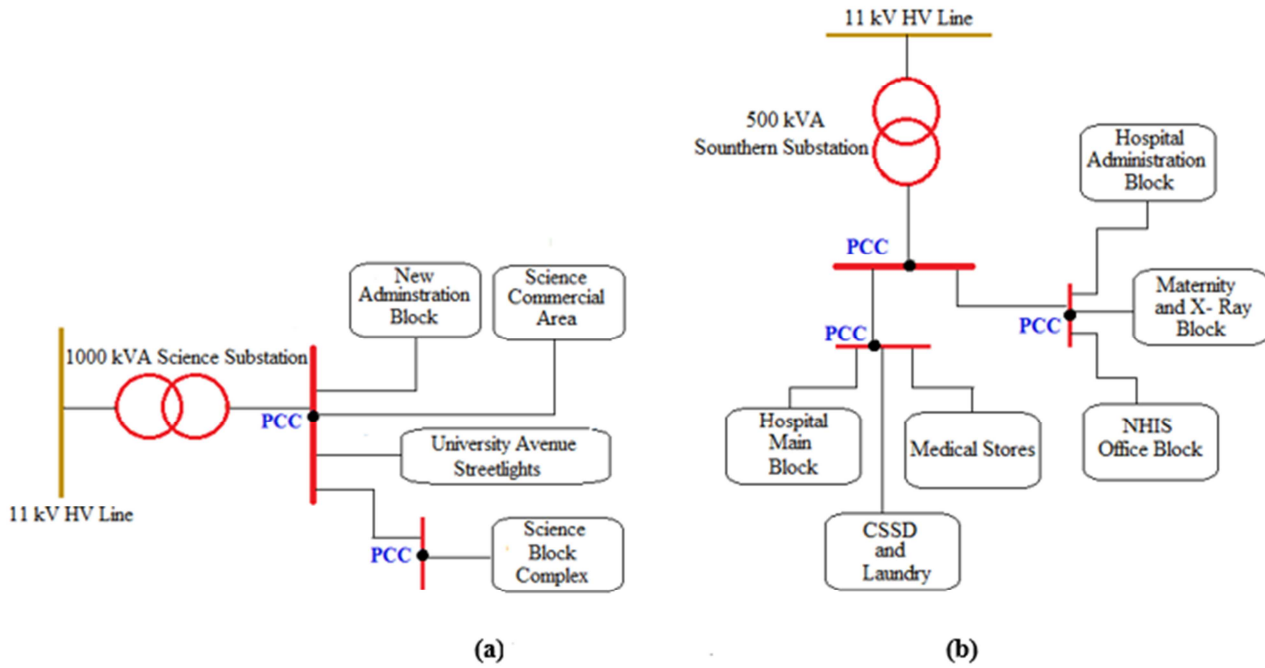


Figure 1. (a) Typical Distribution Arrangement showing the Location of PCCs at Science Complex LV Network, (b) Typical Distribution Arrangement showing the Location of PCCs at University Hospital LV Network.

3.4. Measurement Procedure

Chauvin Arnoux CA 8335 energy analyser qualistar+ was employed for the purposes of harmonic measurements for this paper owing to its shock resistant and rugged built including the ergonomics and simplicity of its interface which makes it simple and intuitive to use.

The analyser was installed with appropriate settings to capture measured data over a period of time as specified by IEEE 519-2014 standard. The duration for measurements as prescribed by the standard offers adequate period of time to sufficiently record and characterize the time varying nature of harmonic currents.

The transformers are strategically located close to the load centres on the university campus where the LV sides of the transformer are hooked directly onto the feeder pillars. The transformers and LV feeder pillars are housed separately in the same power house.

Choosing PCC involves identifying the PCC as specified by IEEE 519-2014 harmonic standard. Setting up is the process that deals with the correct way of installing the power analysing instrument at the PCC.

3.5. Determination of Short Circuit Ratio

Define The Short Circuit Ratio (SCR) at a particular location refers to the ratio of short-circuit current available, in amperes, to the load current, in amperes. The short circuit current I_{SC} is calculated using equation 4.

$$I_{SC} = \frac{kVA \times 100}{\sqrt{3} \times V_{L-L} \times (Z_{P.U} + Z_{System})} \quad (4)$$

where kVA = transformer rating; V_{L-L} = line to line secondary voltage of the transformer at normal tapping; $Z_{P.U}$ = per unit impedance of the transformer at normal tapping; Z_{System} = estimated system impedances comprising service entrance equipment, cables and LV feeder pillars obtained from the UCC Electricity Section as 0.0155 per unit.

Equation 5 gives the relationship between the load current and short circuit current.

$$SCR = \frac{I_{SC}}{I_L} \quad (5)$$

where I_{sc} = short circuit current and I_L = maximum rated current obtained from the transformer nameplate.

The SRC values for each LV bus at the various PCCs were computed using the parameters given in Table 2 and equations 4 and 5. The summary SCR values for each substation are depicted in Table 4.

Since the SCR values are not up to 20, current distortion limits corresponding with values stated in the $SCR < 20$ category for which the maximum allowable THD_i values for daily 99th percentile is 8%, 4%, 3% and 1.5% for harmonic orders up to the 11th, 17th, 23rd, and 35th respectively was applied in this study. Similarly, voltages at the LV buses across

the PCCs are less than 1.0 kV and therefore a recommended THD_V limit of 12% was used.

Table 4. Summary of SCR Values for each Substation.

| Name of Substation | Transformer Capacity (kVA) | Per Unit Impedance | I_L (A) | I_{SC} (kA) | SCR |
|--------------------|----------------------------|--------------------|-----------|---------------|-------|
| Auditorium | 1000 | 0.0454 | 1342 | 22.05 | 16.43 |
| Atlantic | 1000 | 0.0455 | 1342 | 22.01 | 16.40 |
| Science | 1000 | 0.0436 | 1332 | 22.56 | 16.90 |
| Control Station | 1000 | 0.0561 | 1440 | 20.19 | 14.02 |
| CoDE | 1000 | 0.0447 | 1334 | 22.15 | 16.60 |
| SRC/Medical | 1000 | 0.0465 | 1333 | 21.51 | 16.14 |
| Library | 1000 | 0.0456 | 1342 | 21.98 | 16.37 |
| Northern | 750 | 0.0455 | 1008 | 16.40 | 16.42 |
| Casford | 750 | 0.0450 | 1000 | 16.53 | 16.53 |
| Hilltop | 630 | 0.0454 | 840 | 13.79 | 16.42 |
| Superannuation | 500 | 0.0405 | 696 | 12.42 | 17.74 |
| Ghana Hostels | 500 | 0.0441 | 667 | 11.19 | 16.78 |
| Southern | 500 | 0.0400 | 720 | 12.01 | 16.68 |
| Valco-Trust | 500 | 0.0500 | 667 | 10.18 | 15.26 |
| Tech Village | 100 | 0.0428 | 135 | 2.30 | 17.10 |
| Filling Station | 50 | 0.0565 | 69 | 1.18 | 17.20 |

3.6. Measurement Setup

Typical measurement setups at some of the substations and facilities of the university are illustrated in Figures 2 and 3.

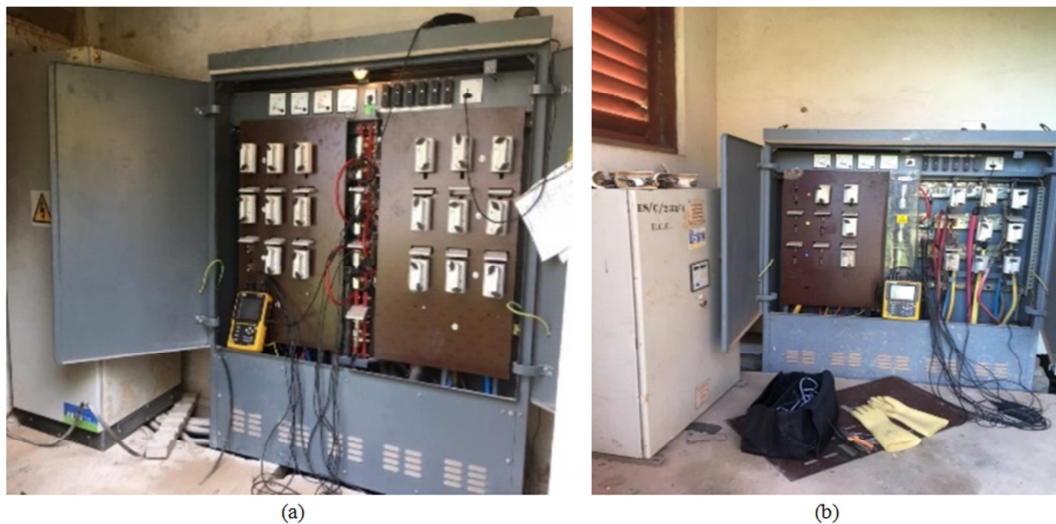


Figure 2. (a) Measurement Setup at the Science Substation; (b) Measurement Setup at the Library Substation.



Figure 3. (a) Measurement Setup at the Auditorium Substation; (b) Measurement Setup at the Control Station.

3.7. Monitoring Duration

Harmonic measurements are performed over a period to characterize the variable nature of the harmonic levels. For very stable conditions such as those encountered in a commercial facility like hospitals, schools and universities, interdepartmental stores and shopping malls, banks and other businesses, measurements over single day are adequate to characterize the varying levels of harmonics.

However, for facilities such as steel plants with arc furnaces or manufacturing and production firms with varying production demands from clients, conducting a weeklong measurement is recommended [23]. Moreover, where operational characteristics vary from day to day, it is recommended to monitor over longer periods. Again, for a university environment, where the load types are similar throughout, the expected spectra content can easily be characterized in short term measurement.

The IEEE 519-2014 Standard recommends the measurement window widths such as: very short time harmonic measurements and short time harmonic measurements.

3.7.1. Very Short Time Harmonic Measurements

Very short time harmonic values are assessed over a 3-second interval based on an aggregation of 15 consecutive 12 (10) cycle windows for 60 (50) Hz power systems. Individual frequency components are aggregated based on rms calculation as shown in equation 6.

$$F_{n,vs} = \sqrt{\frac{1}{15} \sum_{i=1}^{15} F_{n,i}^2} \quad (6)$$

where F = voltage (V) or current (I), in rms value; n = harmonic order; i = simple counter; vs = “very short”.

For very short time harmonic measurements, the duration is 24 hours (1 day) and the 99th percentile value (values should be less than 1.5 times and 2 times for voltages and currents respectively of the values recommended) should be calculated for each 24-hour period for comparison with the

recommended limits in Clause 5 of the IEEE 519- 2014 Standard. This is applied to both voltage and current harmonics.

3.7.2. Short Time Harmonic Measurements

Short time harmonic values are assessed over a 10-minute interval based on an aggregation of 200 consecutive very short time values for a specific frequency component. The 200 values are aggregated based on rms calculation as shown in equation 7.

$$F_{n,sh} = \sqrt{\frac{1}{200} \sum_{i=1}^{200} F_{n,i}^2} \quad (7)$$

where F = voltage (V) or current (I), in rms value; n = harmonic order; i = simple counter; sh = “short”.

The duration for short time harmonic measurement is a 7-day period (1 week); the 95th and 99th percentile values (i.e., for values exceeding 5% and 1% of the measurement period) should be calculated for each 7-day period for comparison with the recommended limits in Clause 5 of the IEEE 519-2014 Standard. These statistics should be used for both voltage and current harmonics with the exception that the 99th percentile short time value is not recommended for use with voltage harmonics [23].

In this paper, the “very short time” measurement duration was found optimal and was selected in view of time constraints, resources, similarity of electric loads and the large area to be considered for the measurement. Furthermore, the stable operating conditions prevailing on the distribution network of the university permits the adoption of the “very short time” measurement method.

3.8. Recommended Harmonic Limits

The IEEE 519-2014 prescribes the daily percentile values of each harmonic and THD at the PCC for voltage and current limits. Limits for line-to-neutral voltage harmonics in 415 V systems with daily 99th percentile very short time (3 s) harmonic currents are applied with respect to Table 5 [23].

Table 5. Voltage Distortion Limits.

| Bus Voltage at PCC | Individual Harmonic (%) | Total Harmonic Distortion THD (%) |
|--------------------|-------------------------|-----------------------------------|
| V ≤ 1.0 kV | 7.5 | 12 |

Limits for the current distortion by odd harmonics in 415 V systems daily 99th percentile very short time (3 s) harmonic currents are applied according to the ratio I_{sc}/I_L shown in Table 6 [23].

Table 6. Current Distortion Limits.

| Maximum Harmonic Current Distortion in Percent of I_L | | | | | |
|---|-----------------|------------------|------------------|------------------|------|
| Individual Harmonic Order (Odd Harmonics) | | | | | |
| I_{sc}/I_L | $3 \leq h < 11$ | $11 \leq h < 17$ | $17 \leq h < 23$ | $23 \leq h < 35$ | TDD |
| < 20 | 8.0 | 4.0 | 3.0 | 1.2 | 10.0 |
| 20 < 50 | 14.0 | 7.0 | 5.0 | 2.0 | 16.0 |
| 50 < 100 | 20.0 | 9.0 | 8.0 | 3.0 | 24.0 |
| 100 < 1000 | 24.0 | 11.0 | 10.0 | 4.0 | 30.0 |
| > 1000 | 30.0 | 14.0 | 12.0 | 5.0 | 40.0 |

3.9. Modelling and Simulation Software

Complexities arise from harmonics studies in relation to its propagation and interaction of voltage and current distortions where the impedance is shared including partial cancellation due to diversity of phase angles. Owing to this, it is necessary to model the affected network and conduct harmonic analysis to examine and identify possible violations of harmonic distortions limits including designing and testing filters for mitigation.

Several software are employed for power system analysis. In this paper, ETAP 16.0.0 was chosen to model the UCC distribution network and to conduct harmonic load flow studies.

4. Results and Discussions

4.1. Results

Two results are presented. Results obtained from a harmonic field study conducted at PCCs located at 16 substations including 5 special installations identified and results obtained from ETAP simulations of the modelled UCC distribution network.

4.1.1. Results of Harmonic Field Study at PCCs Located at the 16 Distribution Substations and at 5 Identified Special Installations


The field study results are presented in Table 7 and Table 8 for the main PCCs and special installation PCCs respectively. This captures the 99th percentile values of THD_V and THD_I as specified by the very short time measuring method prescribed by the IEEE 519-2014 Standard. The bolded values in Table 7 and Table 8 are those which did not violate the limits set by the harmonic standard.

Table 7. Field Results on Three Phase System at Main PCCs.


| Location of Main PCCs | 99 th Percentile Values of Current and Voltage THD (%) | | | | | |
|-----------------------|---|------|------|------------------|-----|-----|
| | THD _I | | | THD _V | | |
| | A1 | A2 | A3 | V1 | V2 | V3 |
| Auditorium | 14.5 | 18.7 | 24.3 | 13.0 | 6.8 | 9.5 |
| Atlantic | 70.5 | 34.2 | 34.8 | 1.6 | 1.6 | 1.5 |
| Science | 9.8 | 7.7 | 11.2 | 1.9 | 2.4 | 1.5 |
| Control Station | 8.5 | 9.2 | 10.1 | 1.7 | 1.5 | 1.5 |
| CoDE | 10.4 | 7.9 | 12.0 | 2.3 | 2.2 | 2.4 |
| SRC/Medical | 11.2 | 11.2 | 10.0 | 1.5 | 1.6 | 1.6 |
| Library | 6.3 | 6.7 | 7.4 | 1.9 | 1.5 | 1.4 |
| Northern | 10.2 | 8.6 | 10.0 | 2.9 | 2.5 | 2.6 |
| Casford | 18.4 | 16.0 | 12.3 | 1.4 | 1.9 | 1.6 |
| Hilltop | 7.3 | 6.6 | 7.6 | 1.1 | 1.1 | 1.1 |
| Superannuation | 22.9 | 16.6 | 24.6 | 1.7 | 1.5 | 1.5 |
| Ghana Hostels | 21.9 | 24.4 | 68.4 | 1.8 | 2.1 | 1.7 |
| Southern | 17.9 | 31.3 | 23.6 | 2.7 | 2.2 | 2.6 |
| Valco-Trust | 9.8 | 9.6 | 6.9 | 1.5 | 1.6 | 1.4 |
| Tech Village | 8.0 | 7.2 | 8.5 | 2.4 | 1.6 | 1.7 |
| UCC Filling St. | 17.0 | 11.7 | 28.1 | 1.9 | 1.7 | 1.9 |

Table 8. Field Results obtained from Special Installations PCCs.

| Location of Special Installation PCCs | 99 th Percentile Values of Current and Voltage THD (%) | | | | | |
|---------------------------------------|---|-------|------|------------------|------|------|
| | THD _I | | | THD _V | | |
| | A1 | A2 | A3 | V1 | V2 | V3 |
| Central Administration | 26.8 | 261.9 | 82.9 | 18.6 | 52.8 | 85.3 |
| University Hospital | 17.0 | 14.4 | 20.7 | 2.4 | 1.6 | 1.7 |
| University Press | 39.2 | 28.4 | 25.9 | 2.5 | 2.0 | 2.2 |
| ICT Centre | 32.6 | 27.6 | 26.8 | 15.2 | 23.2 | 8.0 |
| Streetlights | 16.7 | 15.8 | 20.4 | 2.5 | 2.0 | 2.2 |

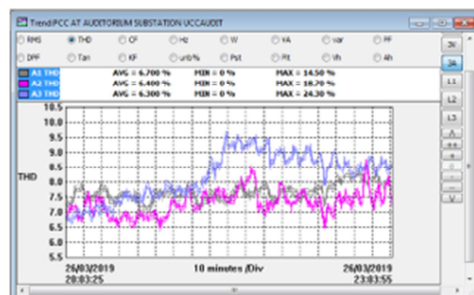

(a)

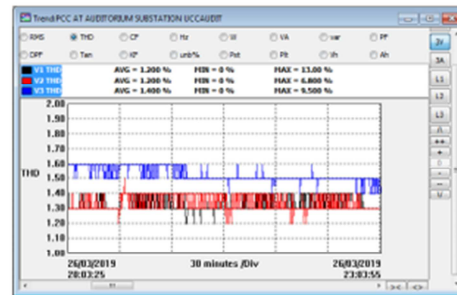

(b)

Figure 4. (a) Waveforms of THD_I at the Auditorium PCC; (b) Waveforms of THD_V at the Auditorium PCC.

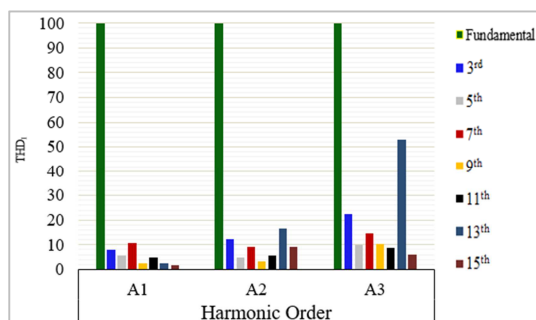


Figure 5. THD_I Harmonic Spectrum for Auditorium PCC.

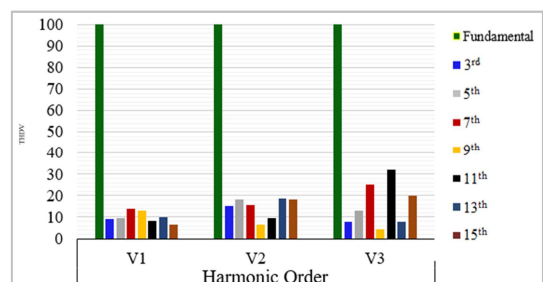


Figure 6. THD_V Harmonic Spectrum for Auditorium PCC.

Figure 4 shows the waveforms of THD_I and THD_V at the

Auditorium PCC, while their corresponding harmonic spectra up to the 15th harmonic order are displayed in Figure 5 and Figure 6. The results for the remaining 15 substations in addition to 5 special installations were also analysed.

Table 9. Averages of THD for Field Results on Three Phase System at Main PCCs.

| Location of Main PCCs | Average THD _I (%) | Average THD _V (%) |
|-----------------------|------------------------------|------------------------------|
| Auditorium | 19.17 | 9.77 |
| Atlantic | 46.50 | 1.57 |
| Science | 9.57 | 1.93 |
| Control Station | 9.27 | 1.57 |
| CoDE | 10.10 | 2.30 |
| SRC/Medical | 10.80 | 1.57 |
| Library | 6.80 | 1.60 |
| Northern | 9.60 | 2.67 |

| Location of Main PCCs | Average THD _I (%) | Average THD _V (%) |
|-----------------------|------------------------------|------------------------------|
| Casford | 15.57 | 1.63 |
| Hilltop | 7.17 | 1.10 |
| Superannuation | 21.37 | 1.57 |
| Ghana Hostels | 38.23 | 1.87 |
| Southern Substation | 24.27 | 2.50 |
| Valco-Trust | 8.77 | 1.50 |
| Tech Village | 6.80 | 1.60 |
| UCC Filling St. | 18.93 | 1.83 |
| Average THD | 16.43 | 2.29 |

4.1.2. Results from Harmonic Analysis and Simulation Using ETAP Software

Harmonic waveforms and their respective spectrums of 8 LV buses and 9 LV buses with filters switched OFF and ON are depicted in Figure 7 to Figure 10.

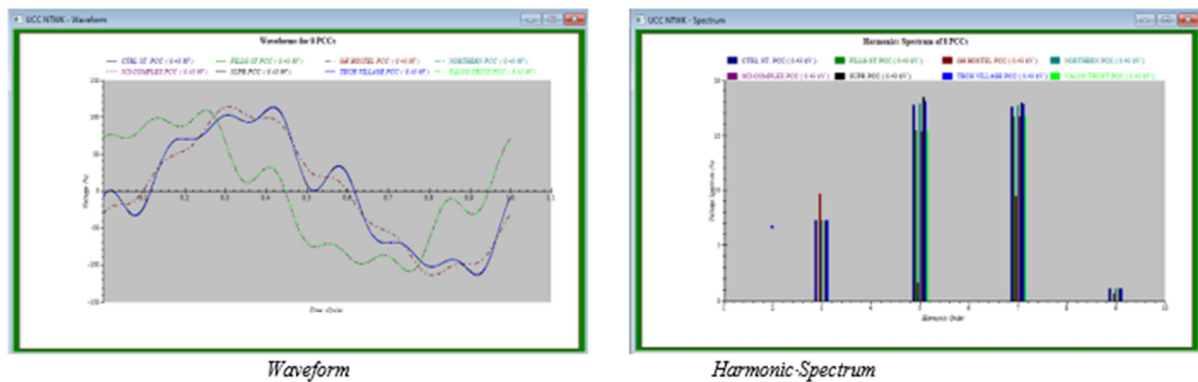


Figure 7. Waveform and corresponding Harmonic Spectrum of Eight (8) LV Buses with Filters Switched-OFF.

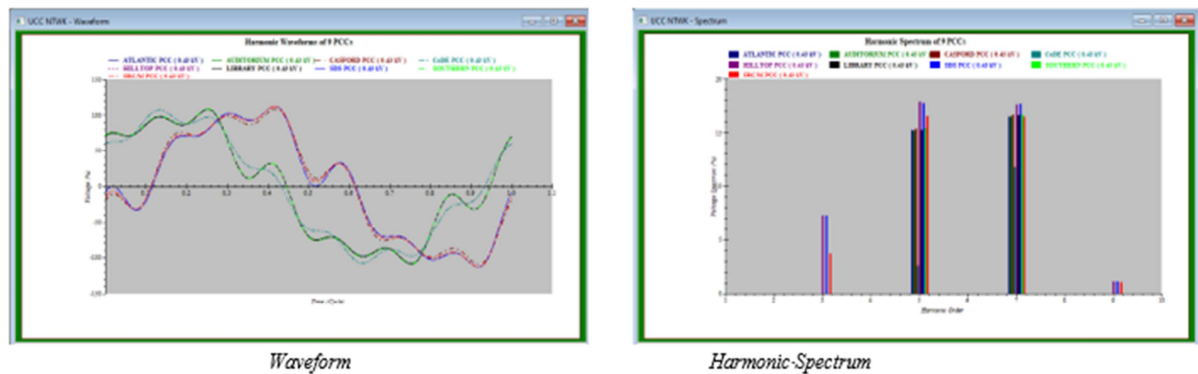


Figure 8. Waveform and corresponding Harmonic Spectrum of Nine (9) LV Buses with Filters Switched-OFF.

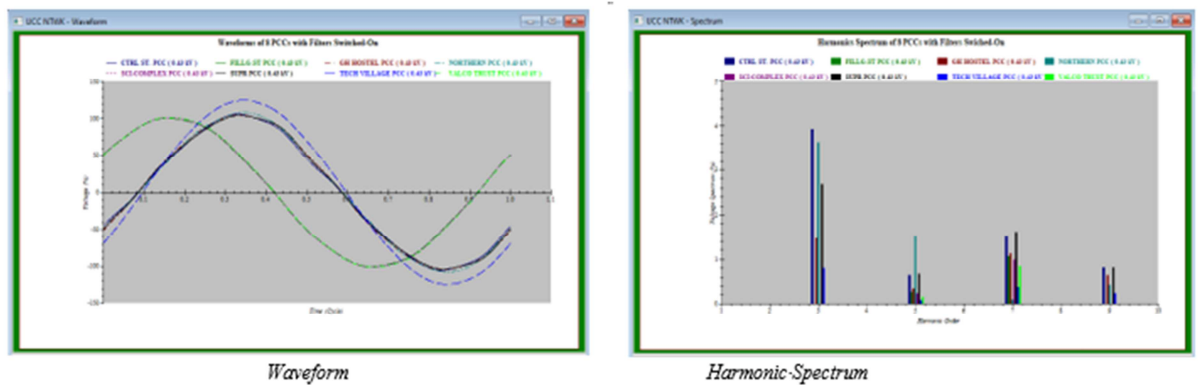


Figure 9. Waveform and corresponding Harmonic Spectrum of Eight (8) LV Buses with Filters Switched-ON.

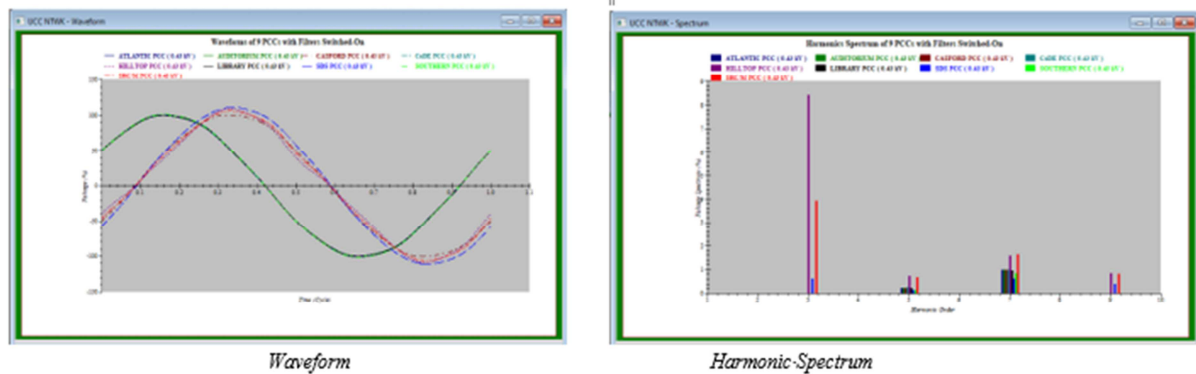


Figure 10. Waveform and corresponding Harmonic Spectrum of Nine (9) LV Buses with Filters Switched-ON.

4.1.3. Results on Cost Savings of Improved True Power Factor by Harmonics Mitigation

Power factors which are usually indicated on utility bills are not the actual or true power factors but rather displacement power factors. The distortion power factor obtained from the

harmonic field measurement indicates an average of 0.944 across all PCCs as shown in Table 10. Table 11 shows a summary of 2017 SLT billing elements recorded for UCC energy consumption at an energy charge of Gh¢ 0.7809. However, the Contracted kVA Demand for UCC is 2109.5.

Table 10. Field Results for Measured Power Factors at Main PCCs.

| Location of Main PCC | Displacement Power Factor (DPF) | Distortion Power Factor (δ PF) | True Power Factor (TPF) |
|---|---------------------------------|--|-------------------------|
| Auditorium | 0.989 | 0.967 | 0.854 |
| Atlantic | 0.987 | 0.864 | 0.896 |
| Science | 0.992 | 0.908 | 0.927 |
| Control Station | 0.994 | 0.935 | 0.879 |
| CoDE | 0.996 | 0.884 | 0.985 |
| SRC/Medical | 0.998 | 0.989 | 0.981 |
| Library | 0.997 | 0.983 | 0.954 |
| Casford | 0.988 | 0.957 | 0.924 |
| Hilltop | 0.985 | 0.935 | 0.927 |
| Northern | 0.991 | 0.941 | 0.930 |
| Superannuation | 0.992 | 0.939 | 0.959 |
| Ghana Hostels | 0.988 | 0.943 | 0.932 |
| Southern | 0.989 | 0.967 | 0.956 |
| Valco-Trust | 0.985 | 0.941 | 0.927 |
| Tech Village | 0.993 | 0.965 | 0.958 |
| Filling Station | 0.979 | 0.958 | 0.938 |
| Average Power Factors Measured at Main PCCs | 0.991 | 0.944 | 0.935 |

Table 11. Summary of Registered Power Components of Monthly Electricity SLT Bill for UCC in 2017.

| Month | Active Energy Consumed (kWh) | Apparent Energy Consumed (kVAh) | Maximum Demand (kVA) | Displacement PF (DPF) | Distortion PF (δ PF) | True PF (TPF) |
|-------|------------------------------|---------------------------------|----------------------|-----------------------|------------------------------|---------------|
| Jan | 513887.87 | 529411.00 | 1779.11 | 0.971 | 0.955 | 0.927 |
| Feb | 680594.96 | 695640.00 | 2119.16 | 0.978 | 0.948 | 0.928 |
| Mar | 818970.91 | 830763.00 | 2083.00 | 0.986 | 0.942 | 0.929 |
| Apr | 763126.00 | 775512.00 | 2099.00 | 0.984 | 0.945 | 0.930 |
| May | 744062.57 | 755843.00 | 2010.73 | 0.984 | 0.946 | 0.931 |
| Jun | 545832.18 | 557596.00 | 1593.73 | 0.979 | 0.952 | 0.932 |
| Jul | 507789.66 | 519783.00 | 1291.90 | 0.977 | 0.955 | 0.933 |
| Aug | 458425.89 | 470685.00 | 1170.57 | 0.974 | 0.958 | 0.933 |
| Sep | 640079.41 | 651703.00 | 1632.91 | 0.982 | 0.951 | 0.934 |
| Oct | 796549.44 | 807790.00 | 1936.63 | 0.986 | 0.948 | 0.935 |
| Nov | 806671.03 | 816848.81 | 2016.99 | 0.988 | 0.948 | 0.936 |
| Dec | 686504.00 | 698015.00 | 1717.00 | 0.984 | 0.953 | 0.937 |

To reduce the THD_v from the recorded average of 16.43% to 8% (8% being the recommended limit for daily 99th percentile monitoring method for harmonics orders up to 11th harmonics), the distortion PF must be improved from an average of 0.9424

to 0.9968 in the distribution system. To achieve that, a multiplier K derived by substituting 8% into equation (1) yielded a value of 1.003195. Multiplying K by the displacement power factors in Table 11 yielded the improved values of new

true power factor (New TPF) in Table 12 and the corresponding potential cost savings of Gh¢ 690 360.43 calculated in Table 13.

Table 12. Calculated Consumption Elements of Monthly Electricity Bill for UCC in 2017.

| Month | Energy Charge @ 0.7809 | Calculated Reactive Energy (kVArh ₁) | New True Power Factor (New TPF) | Apparent Energy Consumed (kVAh ₂) | Reactive Energy Consumed (kVArh ₂) | kVArh _(diff) (kVArh ₁ -kVArh ₂) |
|-------|------------------------|--|---------------------------------|---|--|---|
| Jan | 401295.04 | 127260.61 | 0.974 | 500413.63 | 120053.52 | 7207.10 |
| Feb | 531476.60 | 143894.09 | 0.981 | 668002.78 | 132770.67 | 11123.43 |
| Mar | 639534.38 | 139476.92 | 0.989 | 809925.67 | 122738.29 | 16738.63 |
| Apr | 595925.09 | 138049.16 | 0.987 | 753337.07 | 123421.41 | 14627.75 |
| May | 581038.46 | 132926.79 | 0.988 | 734805.98 | 118475.13 | 14451.67 |
| Jun | 426240.35 | 113932.13 | 0.982 | 536023.69 | 104896.50 | 9035.63 |
| Jul | 396532.95 | 111013.64 | 0.980 | 497658.01 | 102984.72 | 8028.92 |
| Aug | 357984.78 | 106724.28 | 0.977 | 447912.60 | 99905.76 | 6818.53 |
| Sept | 499838.01 | 122536.32 | 0.985 | 630671.71 | 110969.19 | 11567.13 |
| Oct | 622025.46 | 134289.51 | 0.989 | 787974.86 | 117830.13 | 16459.39 |
| Nov | 629929.41 | 128545.08 | 0.991 | 799165.26 | 110817.45 | 17727.63 |
| Dec | 536090.97 | 126242.62 | 0.987 | 677340.04 | 113307.94 | 12934.68 |

Table 13. Calculated Energy Savings from Monthly Electricity Bill for UCC in 2017.

| Month | New True Power Factor (New TPF) | kVArh(diff) Converted to kWh | Energy Charge @ 0.7809 (Gh¢) |
|------------------------------|---------------------------------|------------------------------|------------------------------|
| Jan | 0.974 | 30849.91 | 24 090.69 |
| Feb | 0.981 | 57019.74 | 44 526.71 |
| Mar | 0.989 | 111688.43 | 87 217.49 |
| Apr | 0.987 | 90444.75 | 70 628.31 |
| May | 0.988 | 90761.20 | 70 875.42 |
| Jun | 0.982 | 47017.19 | 36 715.72 |
| Jul | 0.980 | 39588.42 | 30 914.59 |
| Aug | 0.977 | 31287.38 | 24 432.32 |
| Sept | 0.985 | 66720.17 | 52 101.78 |
| Oct | 0.989 | 111267.93 | 86 889.13 |
| Nov | 0.991 | 129044.31 | 100 770.70 |
| Dec | 0.987 | 78367.94 | 61 197.52 |
| Annual Cost Savings for 2017 | | | 690 360.40 |

With similar iterations where 8% THD₁ is assumed to be the average harmonic levels in the distribution system, the SLT bills for 2018 and 2019 yielded potential cost savings of Gh¢ 790 276.65 and Gh¢ 1 460 575.27 respectively as indicated in Table 14. The estimated average annual cost of harmonic disturbances amounted to Gh¢ 1 161 493.71.

Table 14. Estimated Average Annual Cost of Harmonic Disturbances.

| Year | Estimated Annual Cost of Replacement of Selected Harmonic Loads (Gh¢) | Cost Savings of Harmonic Mitigation (Gh¢) | Estimated Total Cost of Harmonic Disturbances (Gh¢) |
|--|---|---|---|
| 2017 | 193 018.00 | 690 360.40 | 883 378.40 |
| 2018 | 166 795.00 | 790 276.65 | 957 071.65 |
| 2019 | 183 455.80 | 1 460 575.27 | 1 644 031.07 |
| Estimated Average Annual Cost of Harmonic Disturbances | | | 1 161 493.71 |

4.2. Discussions

4.2.1. Harmonic Field Study

The field results obtained are weighted against the bus voltages of the PCCs and SCR values calculated for each LV bus at the PCCs to determine the respective voltage and current distortion limits prescribed in Table 5 and Table 6 by IEEE 519-2014 harmonic standard.

In accordance with current distortion limits of Table 6, field results for THD₁ obtained for Auditorium substation in Figure 4 clearly are in violation of the prescribed limits. The 99th percentile (maximum) values recorded exceeds 8%. Similarly, THD_v of voltage harmonics results for Auditorium substation depicted in Figure 4 marginally exceeded the recommended 12% limit stated in Table 5.

The results obtained from the monitoring at the sixteen (16) locations of main PCC substations including results for Special Installations are summarised in Table 7 and Table 8. The currents and voltages waveforms and the respective harmonic spectrums up to the 15th order where significant values were recorded for only Auditorium substation are shown in Figure 4 to Figure 6. The waveforms and their corresponding harmonic spectrums for the remaining substations were also analysed and it was observed that the 3rd, 5th, 7th, 9th, 11th, 13th and 15th harmonics were the dominant harmonic orders which recorded significant values. The other harmonic orders from the 17th to the 50th mostly recorded values of less significance. The calculated average current harmonics distortions on the UCC distribution network from Table 9 gave a value of 16.43%.

4.2.2. ETAP Simulation

The results from Figure 7 to Figure 10 show that the harmonics of the 3rd, 5th, 7th and 9th orders are dominant whereas the higher order harmonics from 11th to the 50th presented docile or no values. This is because of the typical harmonic components (nonlinear loads) modelling available

in the ETAP software.

A single - tuned passive filter paralleled with other filters singly tuned to a different harmonic order was selected and connected to the PCCs to reduce the harmonics on the modelled network. Table 15 shows the levels of THD reduction achieved when filters were connected to the network.

Table 15. Summary of Simulation Results with Filters Switched ON and OFF.

| LV Bus (PCC) | Simulated Results of THD | | Filter Tuned Harmonic Order |
|-----------------|--------------------------|-----------|---|
| | Filter OFF | Filter ON | |
| Auditorium | 10.44 | 1.00 | 3 rd |
| Atlantic | 10.28 | 1.01 | 3 rd |
| Science | 10.06 | 0.99 | 5 th |
| Control Station | 13.88 | 4.25 | 3 rd , 5 th |
| CoDE | 10.31 | 1.01 | 7 th |
| SRC/Medical | 14.92 | 4.20 | 3 rd , 5 th |
| Library | 10.27 | 0.98 | 5 th |
| Northern | 15.81 | 3.77 | 3 rd , 5 th , 7 th |
| Casford | 9.82 | 0.99 | 3 rd |
| Hilltop | 13.50 | 8.54 | 5 th , 7 th |
| Superannuation | 14.85 | 3.21 | 3 rd , 5 th |
| Ghana Hostels | 13.27 | 1.91 | 3 rd , 5 th |
| Southern | 9.80 | 0.84 | 5 th |
| Valco-Trust | 9.25 | 0.84 | 5 th |
| Tech Village | 10.47 | 0.74 | 5 th , 7 th |
| UCC Filling St. | 9.46 | 1.09 | 5 th |
| SDS | 13.33 | 0.88 | 3 rd , 5 th |

4.2.3. Estimated Cost of Proposed Harmonic Mitigation Equipment

Tuned paralleled passive filters are proposed based on their performance and effectiveness in reducing the resident harmonics as shown by the simulation results of Figure 9 and Figure 10 including other considerations such as lowest cost compared with other harmonics solutions, simplicity of design

with fewer components and additional power factor correction. Typical parameters for simulation purposes were selected based on the maximum line currents and the overall kVar ratings. Since the harmonics of concern are of lower frequency, a high Q factor of 50 at a rated voltage of 0.433 kV was selected with the typical tuning factors as indicated in Table 16 [24].

Table 16. Parameters for Paralleled Single Tuned Passive Filters.

| Harmonic Order | Tuning Order | Parameters of Capacitor, C | | | Parameters of Inductor, L | | |
|------------------|--------------|----------------------------|-------|---------------------|---------------------------|--------------------|-----------|
| | | kVar | μF | V _C (kV) | X _L (Ω) | I _L (A) | I Max (A) |
| 3 rd | 2.95 | 45.42 | 771.1 | 0.629 | 0.4744 | 155.1 | 200 |
| 5 th | 4.81 | 45.42 | 771.1 | 0.526 | 0.1784 | 138.7 | 180 |
| 7 th | 6.73 | 45.42 | 771.1 | 0.492 | 0.0911 | 133.8 | 180 |
| 9 th | 8.66 | 45.42 | 771.1 | 0.472 | 0.0551 | 127.3 | 150 |
| 11 th | 10.59 | 36.33 | 616.8 | 0.466 | 0.0481 | 103.8 | 150 |
| 13 th | 12.51 | 36.33 | 616.8 | 0.454 | 0.0334 | 95.69 | 100 |
| 15 th | 14.44 | 32.70 | 555.2 | 0.451 | 0.0275 | 85.78 | 80 |

The pricing obtained for the mitigation equipment is typical and based on available market price at the time of the research [15, 25]. Table 17 gives a summary of estimated costs of harmonic mitigation equipment.

Table 17. Estimated Cost of Harmonic Mitigation Equipment.

| Location of PCC | Transformer Capacity (kVA) | Max THDI (%) | Max Load (A) | kVar Required | Cost @ \$ 120/kVar |
|-----------------|----------------------------|--------------|--------------|---------------|--------------------|
| Auditorium | 1000 | 24.30 | 1013 | 650 | 78000 |
| Atlantic | 1000 | 70.50 | 684 | 650 | 78000 |
| Science | 1000 | 11.20 | 1051 | 650 | 78000 |
| Control Station | 1000 | 10.10 | 208 | 650 | 78000 |
| CoDE | 1000 | 12.00 | 714 | 650 | 78000 |
| SRC/Medical | 1000 | 11.20 | 432 | 650 | 78000 |
| Library | 1000 | 7.40 | 812 | 650 | 78000 |
| Northern | 750 | 10.20 | 247 | 400 | 48000 |
| Casford | 750 | 18.40 | 171 | 400 | 48000 |
| Hilltop | 630 | 7.60 | 264 | 315 | 37800 |

| Location of PCC | Transformer Capacity (kVA) | Max THDI (%) | Max Load (A) | kVar Required | Cost @ \$ 120/kVar |
|------------------------------------|----------------------------|--------------|--------------|---------------|--------------------|
| Superannuation | 500 | 24.60 | 487 | 270 | 32400 |
| Ghana Hostels | 500 | 68.40 | 357 | 270 | 32400 |
| Southern | 500 | 31.30 | 482 | 270 | 32400 |
| Valco-Trust | 500 | 9.80 | 296 | 270 | 32400 |
| Tech Village | 100 | 7.40 | 72 | 80 | 9600 |
| 50 | 17.00 | 38 | 30 | 3600 | 50 |
| Total Cost of Mitigation Equipment | | | | | 822 600.00 |

The value of kVar required was typically selected based on the maximum THD_I measured at the PCC under consideration and not on the reactive compensation requirement of the system. This is due to the fact that, a danger of overloading may exist when the need for compensation is low and the production of harmonics is dominant within the distribution system. The selection was also done with recourse to the application data of the filter to be applied and expected load current on a particular circuit branch.

4.2.4. Economic Evaluation of Harmonic Disturbances

Based on the assumption that the service life of single-phase loads operated in harmonic environment exceeding 10% THD_I are reduced by 32.5%, this paper therefore safely assumes that 32.5% of the replacements effected on the selected loads are occasioned by the adverse effects of harmonics disturbances in the university since the average total current harmonic distortion was found to be 16.43% as depicted in Table 9. The selected harmonic loads were expected on the average to be in service for the stated duration depicted in Table 1 before attaining obsolescence.

This implies that the university incurred Gh¢ 62 731.00 in 2017 as avoidable cost due to harmonics. Similar computation revealed that, Gh¢ 54 208.20 and Gh¢ 59 623.10 for 2018 and 2019 respectively were lost due to frequent replacement exacerbated by harmonics.

The cost evaluation of harmonic disturbances at the university is estimated at an annual average of Gh¢ 1 161 493.71 as indicated in Table 14. This comprises losses due to reduced service life of equipment and losses due to reduced true power factor of the UCC distribution network. A 25 years life expectancy is assumed for the harmonic mitigating equipment at a total cost of \$ 822 600.00.

The total present values of benefits and cost stand at Gh¢ 7,122,377.98 and Gh¢ 4,386,349.98 respectively; giving a net present value (NPV) of Gh¢ 2,736,028.00. The net present value yielded a positive figure, suggesting that embarking on a harmonic mitigation venture is worthwhile if considered.

The rule of thumb is to assume a slightly higher figure than the stated inflation for a discount factor. Therefore, with inflation of 7.90% [26], a discount factor of 8% was reasonably selected and a discounted payback period (DPBP) based on the present value and payback value yielded 6.23 years. The benefits-costs ratio (BCR) was also deduced to be 1.62.

5. Conclusions

The increasing use of nonlinear loads has given rise to

harmonics problems on electrical distribution systems. The proliferation of these harmonic loads on the electrical distribution systems has unquestionable economic consequences on the overall finances of the university. The rate of replacement of susceptible nonlinear loads has been more frequent in the presence of harmonics distortions including an overall reduction in the true power factor of the system. The veracity of the harmonic distortions in the electrical distribution system of the University of Cape Coast has been ascertained to be high. Additionally, the economic implications of this disturbance have also been evaluated. The following conclusions were drawn from the study:

- The calculated average THD_I over the entire distribution network of 16.43% far exceeded the recommended limits set by the IEEE 519-2014 Standard. This is an indication of the extent of harmonic pollution in the distribution network of the university;
- The high THD_I resulted in an increase in the distortion power factor which is a component of the true power factor. This consequently led to a lowered overall true power factor; and
- A reduced true power factor for a special load tariff consumer such as the university, meant that large sums of money are lost. The analysis showed that, by mitigating the harmonics in the system to effect an overall reduction of the THD_I from an average of 16.43% to 8% leads to a significant savings of up to Gh¢ 1,161,493.71 per annum.

6. Recommendations

The following recommendations are made from the research conducted:

- In view of the daunting outlay that must be expended in embarking upon harmonics mitigation, the university should consider as a matter of policy to gradually replace nonlinear loads with harmonics-compliant load types as a way of reducing the overall harmonics in the electrical distribution system;
- A reconfiguration of the distribution network which aims to separate shared buses of nonlinear loads and linear loads is necessary and should be considered with the nonlinear loads bus connected upstream of the network. This will minimise the overall impacts of harmonics at the main feeder bus and consequently reducing the levels of harmonics distortions; and
- The use of a tuned paralleled passive filter is recommended for harmonics mitigation as it is less expensive and proved effective in reducing the harmonic distortions to tolerable levels.

References

- [1] Arian, O., Kocatepe, C., Ucar, G. and Hacialiefendioglu, Y. (2015), "Influence of Harmonics on Medium Voltage Distribution System: A Case Study for Residential Area", *World Academy of Science, Engineering and Technology International Journal of Electrical and Computer Engineering*, Vol. 9, Issue 8, pp 812 – 816.
- [2] Akpagloh, F., Armah, S. E. and Osei-Owusu, A. (2014), "Evaluating the Financial Implication of Power Harmonics on ECG Distribution Networks and Customers", *International Journal of Emerging Science and Engineering*, Vol. 2, Issue 6, pp. 11 – 20.
- [3] Eduful, G. and Atanga, K. J. (2016), "Analysis of High Neutral Currents and Harmonic Impacts on Losses and Capacities of Distribution Transformers", *Proceedings of World Congress on Engineering*, London, UK, pp. 369 – 376.
- [4] Beleiu, H. G., Beleiu, I. N., Pavel, S. G. and Darab, C. P. (2018), "Management of Power Quality Issues from an Economic Point of View", *Sustainability*, Vol. 10, Issue 7, pp. 1 – 16.
- [5] Pejovski, D., Najdenkoski, K. and Diaglovski, M. (2017), "Impact of Different Harmonic Loads on Distribution Transformers", *Procedia Engineering*, Vol. 202, pp. 76 – 87.
- [6] Elphick, S., Ciufu, P., Smith, V. and Perera, S. (2015), "Summary of the Economic Impacts of Power Quality on Consumers", *Australasian Universities Power Engineering Conference*, Wollongong, Australia, pp. 1 – 6.
- [7] Jiang, C., Salles, D., Xu, W. and Freitas, W. (2012), "Assessing the Collective Harmonic Impact of Modern Residential Loads – Part II: Applications", *IEEE Transactions on Power Delivery*, Vol. 27, Issue 4, pp. 1947 – 1955.
- [8] Das, J. C. (2017), "Harmonic Generation Effects, Propagation and Control", *CRC Press*, Boca Raton, FL, 381 pp.
- [9] Salles, D., Jiang, C., Xu, W., Freitas, W. and Mazin, H. E. (2012), "Assessing the Collective Harmonic Impact of Modern Residential Loads – Part I: Methodology", *IEEE Transactions on Power Delivery*, Vol. 27, Issue 4, pp. 1937 – 1946.
- [10] Zobaa, A. F., Aleem, S. H. E. A. and Balci, M. E. (2018), "Introductory Chapter: Power System Harmonics - Analysis, Effects, and Mitigation Solutions for Power Quality Improvement", <https://www.intechopen.com/books/power-system-harmonics-analysis-effects-and-mitigation-solutions-for-power-quality-improvement/introductory-chapter-power-system-harmonics-analysis-effects-and-mitigation-solutions-for-power-quality>, Accessed: April 2, 2020.
- [11] Gandhare, W. Z. and Patil, K. D. (2013), "Effects of Harmonics on Power Loss in XLPE Cables", *Energy and Power Engineering*, Vol. 5, pp. 1235 – 1239.
- [12] Ajenikoko, G. A. and Ojerinde, A. I. (2015), "Effects of Total Harmonic Distortions on Power System Equipment", *Journal of Innovative Systems Design and Engineering*, Vol. 6, Issue 5, pp. 114 – 120.
- [13] McBee, K. D. (2017), "Transformer Aging Due to High Penetrations of PV and EV Charging and Storage Application", *Proceedings of the 9th Green Technology Conference*, Denver, USA, pp. 163 – 170.
- [14] Anon. (2018), "Electrical Installation Guide 2018 – According to IEC International Standards", *Schneider Electric*, Technical Collection Press, pp. 145 – 157.
- [15] Carnovale, D. J. (2003), "Applying Harmonic Solutions to Commercial and Industrial Power Systems", *Eaton Cutler-Hammer*, <https://www.researchgate.net/publication/242277372>, Accessed: September 17, 2018.
- [16] Fuchs, E. and Masoum, M. S. (2015), "Power Quality in Power Systems and Electrical Machines", *Academic Press*, Massachusetts, 1123 pp.
- [17] Grady, V. M. and Gilleskie, R. J. (1993), "Harmonics and How They Relate to Power Factor", *Proceedings of the EPRI Power Quality Issues & Opportunities Conference*, San Diego, USA, 8 pp.
- [18] Sapkota, S. and Sapkota, S. (2019), "Benefit Cost Analysis of Different Rice Varieties in Kapilvastu District, Nepal", *International Journal of Applied Sciences and Biotechnology*, Vol. 7, Issue 2, pp. 222 – 226.
- [19] Greer, N. and Ksaibati, K. (2019), "Development of Benefit Cost Analysis Tools for Evaluating Transportation Research Projects", *Transportation Research Record*, Vol. 2673 Issue 1, pp. 123 – 135.
- [20] Seal, W., Garrison, R. H., Rohde, C. and Noreen, E. W. (2018), "Management Accounting", 6th Edition, *McGraw-Hill Inc.*, Boston, 865 pp.
- [21] Noreen, E., Brewer, P. and Garrison, R. H. (2017), "Managerial Accounting for Managers", 5th edition, *McGraw-Hill Education*, New York, 640 pp.
- [22] Heydt, G. T. (2018), "The Probabilistic Evaluation of Net Present Value of Electric Power Distribution Systems Based on the Kaldor-Hicks Compensation Principle", *IEEE Transactions on Power Systems*, Vol. 33, Issue 4, pp. 4488 – 4495.
- [23] Anon. (2014), "519-2014 IEEE Recommended Practices and Requirements for Harmonic Control in Electric Power Systems", *IEEE Standards Association*, New York, 213 pp.
- [24] Motta, L. and Faundes, N. (2016), "Active/Passive Harmonic Filters: Applications, Challenges & Trends", *Proceedings of International Conference on Harmonics and Quality of Power*, Belo Horizonte, Brazil, pp. 657 – 662.
- [25] Singh, O. P. (2018), "Cost-Benefit Analysis of Harmonic Current Reduction in PV System – A Review", *Journal of Basic and Applied Engineering Research*, Vol. 4, Issue 3, pp. 267 – 275.
- [26] Anon. (2020), "Ghana Policy Rate and Foreign Exchange", <https://www.bog.gov.gh>, Accessed: February 13, 2020.